


Tray can be placed on one of these panels



- Type safety
- Cut Line
- Bleed Area

**Note:** Any artwork that does not meet above requirement may be put on hold and cause a delay. Client will have to resubmit new file(s) or authorize SUPERLINK to perform artwork modification at extra cost.

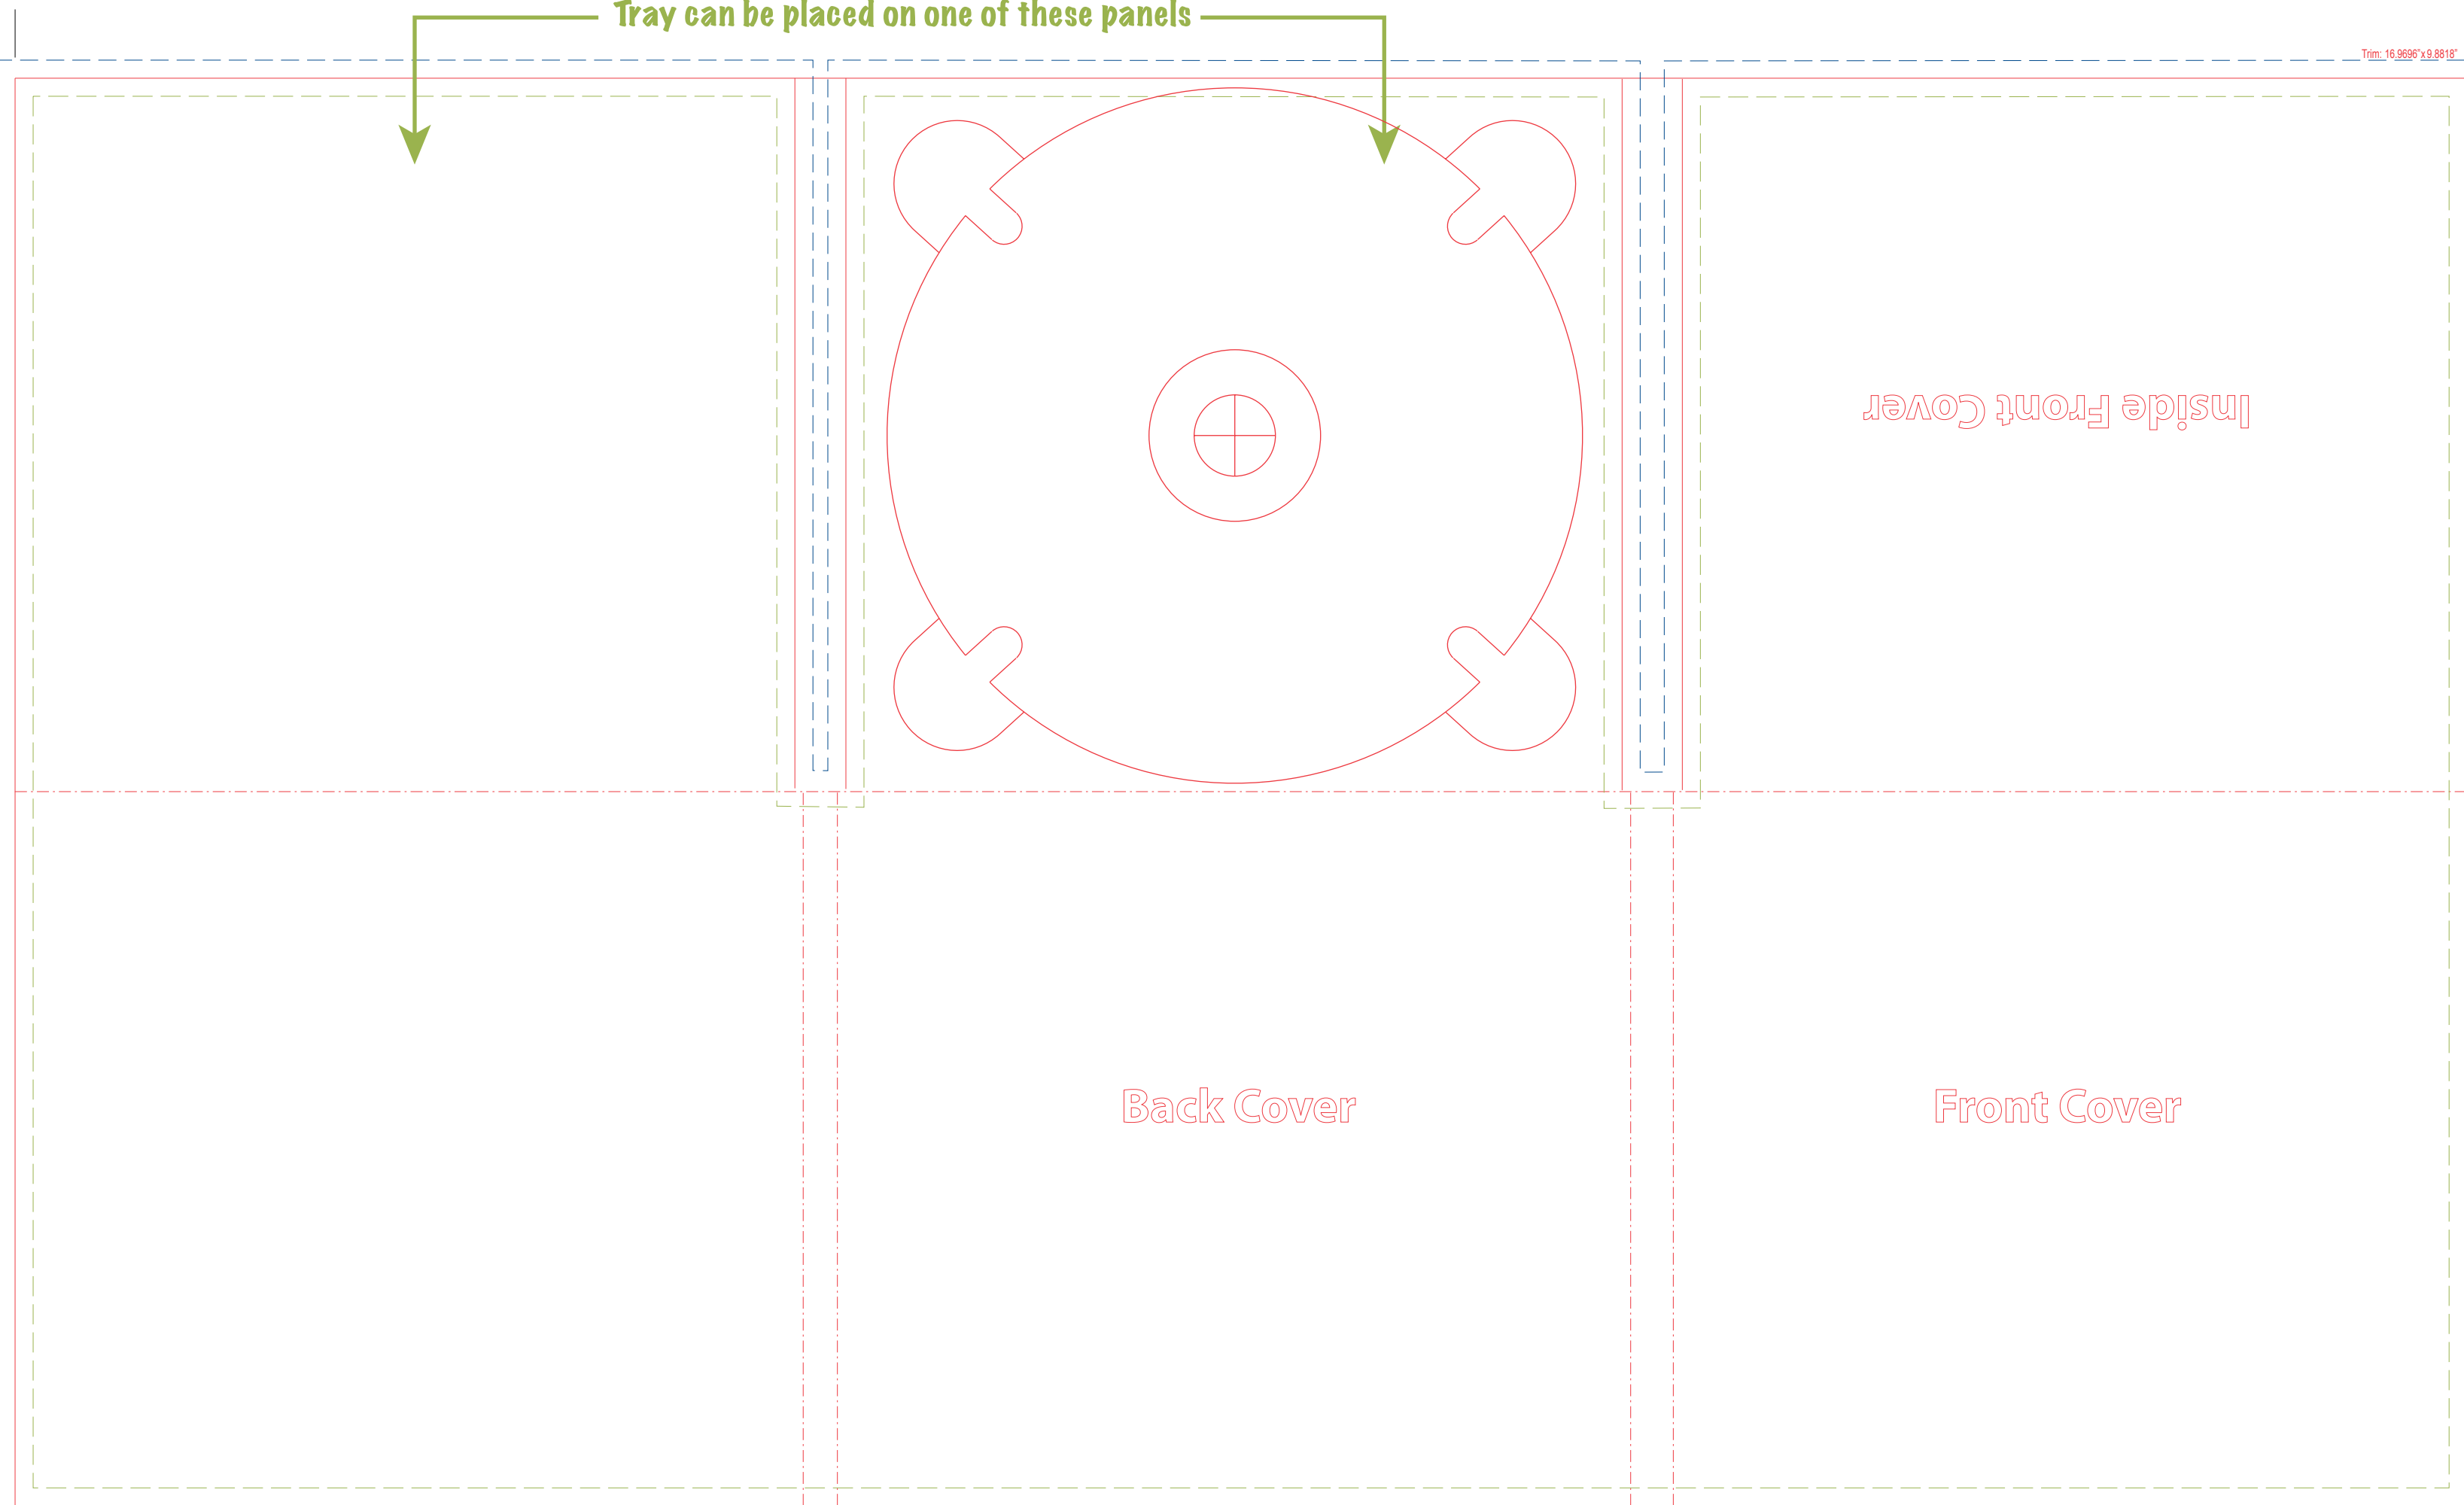